

Water Testing Facilities

Weaverville Sanitary District - Water Testing for Coliform & E. Coli

Contact Jim Cloud at the Weaverville Sanitary District

630 Mountain View St., Weaverville, CA 96093

(530) 623-6529

www.weavervillesd.com


weavervillesd@yahoo.com

WSD is currently the only site in Trinity County that has a minimal testing lab.

Our office requires a well water test for Coliform Bacteria and E. Coli.

WSD only tests whether these two bacteria are present or absent.

You can get your sample bottle from them.

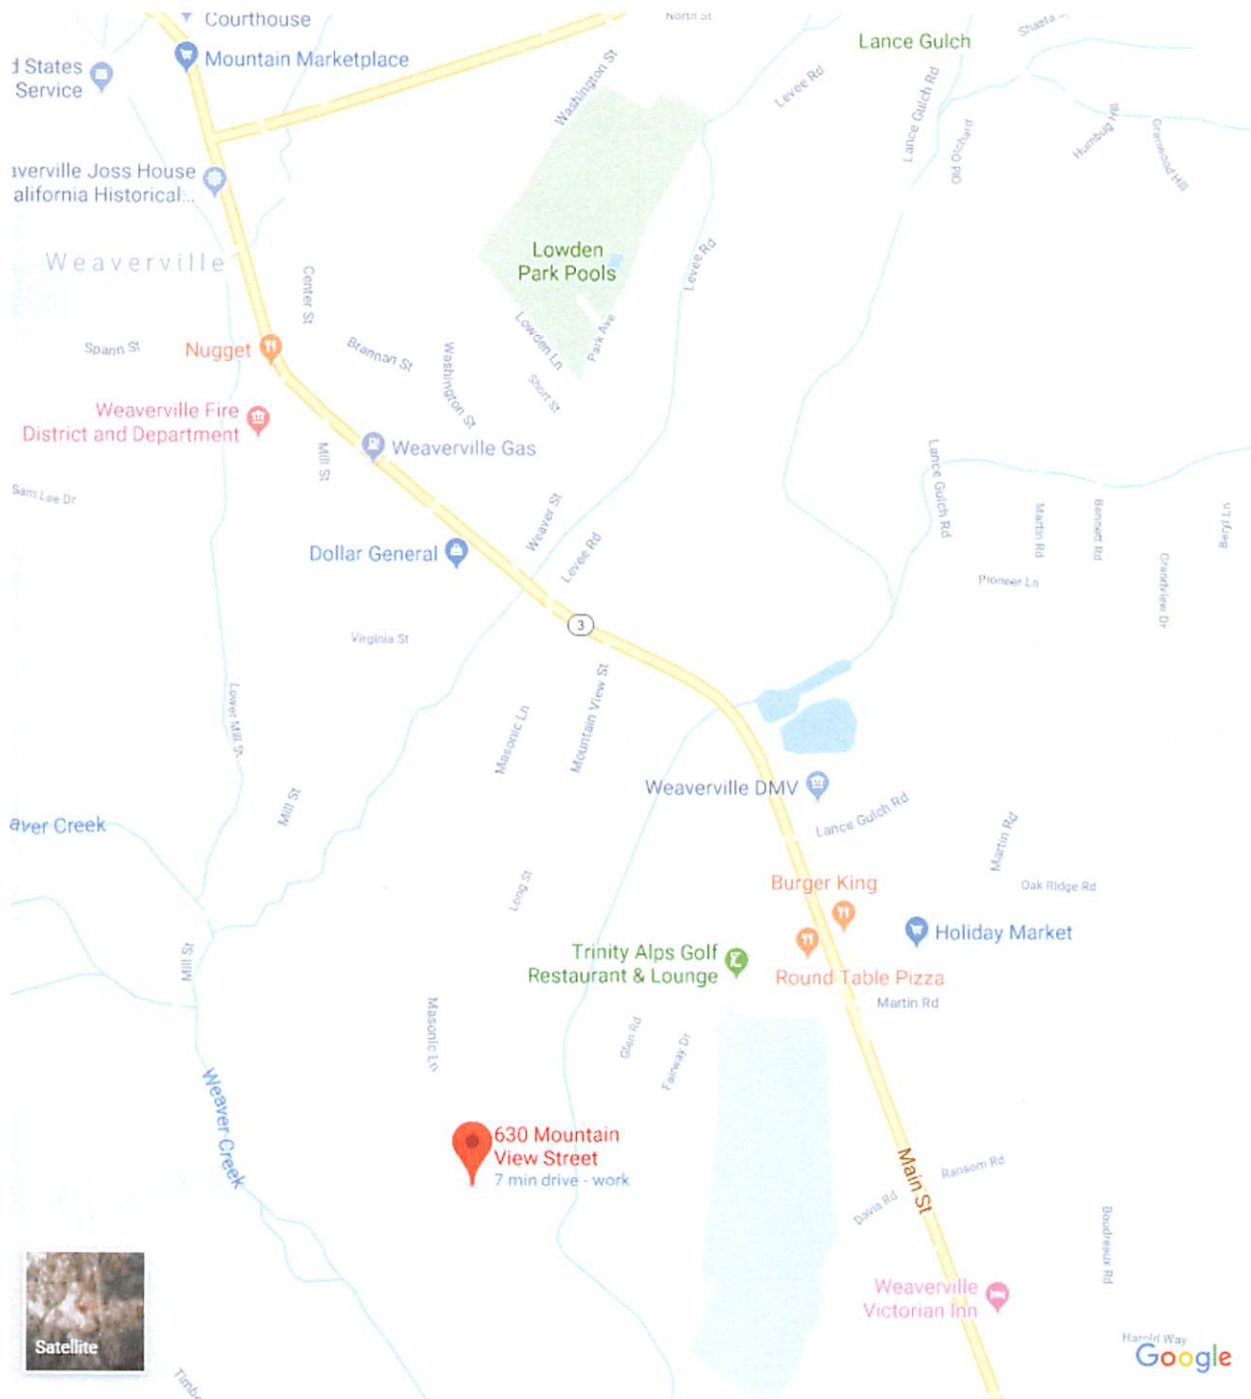

For basic water testing and advanced water testing contact:

Basic Laboratory Inc.

Environmental and Agricultural Testing Services
2218 Railroad Avenue, Redding, CA 96001
530-243-7234 ext. 203
530-243-8847 – Fax
www.basiclab.com

North Coast Laboratories, Inc.

North Coast Labs is open Monday – Friday from 8:30 am – 5:00 pm
They accept bacteria samples during business hours but only until noon on Friday.

Bacteriological, Chemical & Radiological Testing
5680 West End Road, Arcata, CA 95521
707-822-4649
707-822-6831 (Fax)

Visit their website and click the "Contact Us" tab to view a list of contacts for their departments such as Client Services, Sample Receiving, Quality Assurance, Technical Inquiries, etc.

www.northcoastlabs.com

Water Districts in Trinity County

Weaverville Community Service District

Contact: Marlee Rogers or Judy Jurin
716 Main Street, Weaverville, CA
(530) 623-5051
www.weavervillecsd.com

Trinity County Waterworks District #1

Contact: Craig Hair Jr.
320 Reservoir Road, Hayfork, CA
530-628-5449
www.trinitycountywaterworks.com
craig@trinitycountywaterworks.com

Lewiston Park Mutual Water Co

Contact: Jamie Day – Office Manager
CEO – Conner Nixon
415 3rd Ave.
Lewiston, CA 96052
530-778-3502